## IAQ Map Legend - Summer Operation

Natural ventilation: Operable windows and/or louvres should be used to manage fresh air, balancing thermal comfort and ventilation.

Mechanical ventilation: Fresh air is introduced by the heating, ventilation and air conditioning system when in operation. Windows can remain closed and no action is required by the school.

Evaporative cooler: will provide full fresh air when operating in either cooling or fan only mode. At least one window should be open.

Note: White spaces are to be used in accordance with COVID-19 requirements and current health advice.

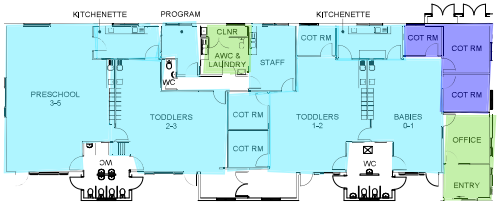


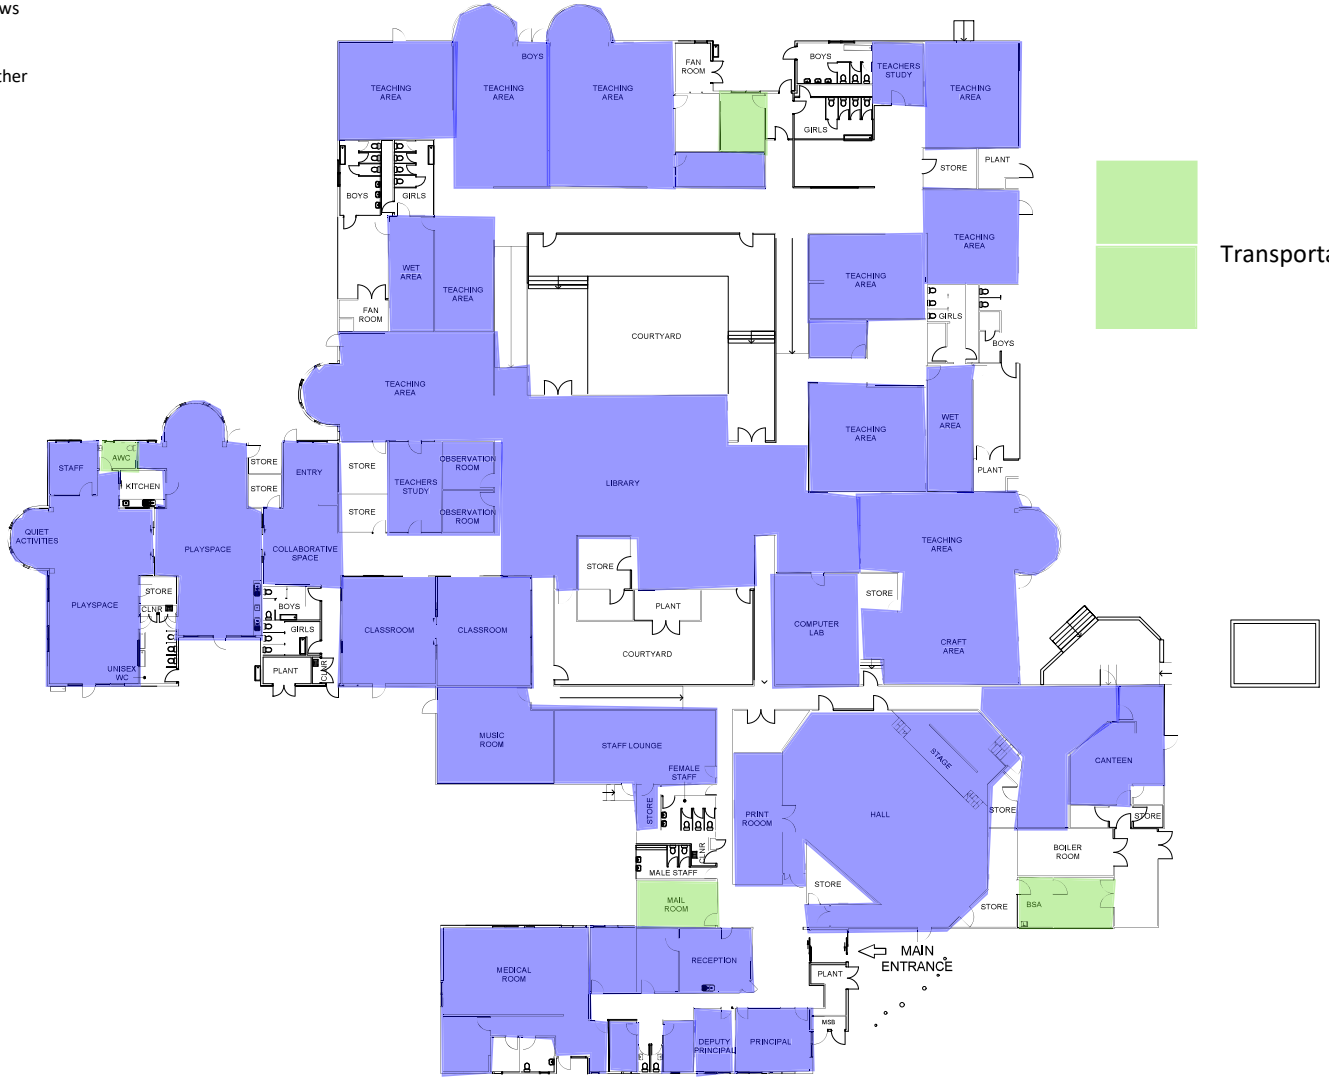


Transportable

| ISSUE | AMENDMENT | DRAWN | VER'D | APP'D | DATE |
|---|---|---|---|---|---|
| | | | | | |

Scale 1:400 - metres
0 1 2 3 4 5 10 15 20

SCALE 1:400
DATE OCTOBER 2017
DRAWING SHEET SIZE = A3

ACT Government Education

PROJECT
TAYLOR PRIMARY SCHOOL
INFRASTUCTURE & CAPITAL WORKS
SCHOOL LAYOUT PLAN